

- Timers multifunctional
- Up to 7 functions
- 7 time ranges
- Wide input voltage range
- 1 change over contact
- Width 17.5 mm
- Installation design



Technical data

1. Functions

The function has to be set before connecting the relay to the supply voltage.

E	ON delay
R	OFF delay
Ws	Single shot leading edge with control input
Wa	Single shot trailing edge with control input
Es	ON delay with control input
Wu	Single shot leading edge voltage controlled
Bp	Flasher pause first

Function sets of the distinct types are according to table ordering information or printing on the unit.

2. Time ranges

Time range	Adjustment range
1s	50ms 1s
10s	500ms 10s
1min	3s 1min
10min	30s 10min
1h	3min 1h
10h	30min 10h
100h	5h 100h

3. Indicators

Green LED U/t ON:	indication of supply voltage
Green LED U/t flashes:	indication of time period
Yellow LED R ON/OFF:	indication of relay output

4. Mechanical design

Self-extinguishing plastic housing, IP rating IP40
 Mounted on DIN-rail TS 35 according to EN 50022
 Mounting position: any
 Shockproof terminal connection according to VBG 4 (PZ1 required), IP rating IP20
 Tightening torque: max. 1Nm
 Terminal capacity:
 1 x 0.5 to 2.5mm² with/without multicore cable end
 1 x 4mm² without multicore cable end
 2 x 0.5 to 1.5mm² with/without multicore cable end
 2 x 2.5mm² flexible without multicore cable end

5. Input circuit

Supply voltage: terminals A1(+)-A2
 Types E1Z..12-240VAC/DC: 12 to 240V AC/DC
 Tolerance: 12V-10% to 240V+10%
 Types E1Z..24-240VAC/DC: 24 to 240V AC/DC
 Tolerance: 24V-15% to 240V+10%
 Rated consumption: 4VA (1.5W)
 Rated frequency: AC 48 to 63Hz
 Duty cycle: 100%
 Reset time: 100ms
 Residual ripple for DC: 10%
 Drop-out voltage: >30% of minimum rated supply voltage
 Overvoltage category: III (according to IEC 60664-1)
 Rated surge voltage: 4kV

6. Output circuit

1 potential free change over contact
 Rated voltage: 250V AC

Switching capacity:

2000VA (8A / 250V)

Fusing:

8A fast acting

Mechanical life:

20 x 10⁶ operations

Electrical life:

2 x 10⁵ operations
 at 1000VA resistive load

Switching frequency:

max. 60/min at 100VA resistive load
 max. 6/min at 1000VA resistive load
 (according to IEC 947-5-1)

Overvoltage category:

III. (according to IEC 60664-1)

Rated surge voltage:

4kV

7. Control input

Input not potential free:

terminals A1-B1

Loadable:

yes

Max. line length:

10m

Trigger level (sensitivity):

automatic adaption to supply voltage
 DC 50ms / AC 100ms

Min. control pulse length:

8. Accuracy

Base accuracy:

±1% of maximum scale value

Adjusting accuracy:

<5% of maximum scale value

Repetition accuracy:

<0.5% or ±5ms

Voltage influence:

-

Temperature influence:

≤0.01% / °C

9. Ambient conditions

Ambient temperature:

-25 to +55°C (according to IEC 68-1)

Storage temperature:

-25 to +70°C

Transport temperature:

-25 to +70°C

Relative humidity:

15% to 85%
 (according to IEC 721-3-3 Klasse 3K3)

Pollution degree:

2, if built-in 3
 (according to IEC 664-1)


Vibrations resistance:

10 to 55 Hz 0.35mm
 (according to IEC 68-2-6)

Shock resistance:

15g 11ms
 (according to IEC 68-2-27)

10. Dimensions

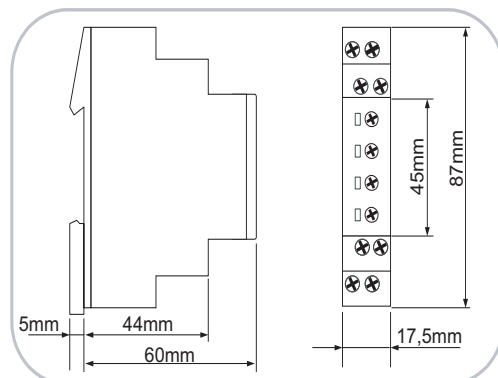

11. Weight

Single packing:

72g


Package 10pcs:

670g per Package

Functions


ON delay (E)

When the supply voltage U is applied, the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay R switches into on-position (yellow LED illuminated). This status remains until the supply voltage is interrupted. If the supply voltage is interrupted before the expiry of the interval t, the interval already expired is erased and is restarted when the supply voltage is next applied.




OFF delay (R)

The supply voltage U must be constantly applied to the device (green LED U/t illuminated). When the control contact S is closed, the output relay R switches into on-position (yellow LED illuminated). If the control contact is opened, the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated). If the control contact is closed again before the interval t has expired, the interval already expired is erased and is restarted.

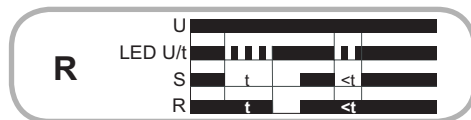

Single shot leading edge with control input (Ws)


The supply voltage U must be constantly applied to the device (green LED U/t illuminated). When the control contact S is closed, the output relay R switches into on-position (green LED U/t illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated). During the interval, the control contact can be operated any number of times. A further cycle can only be started when the cycle run has been completed.



Connections

with control input

without control input

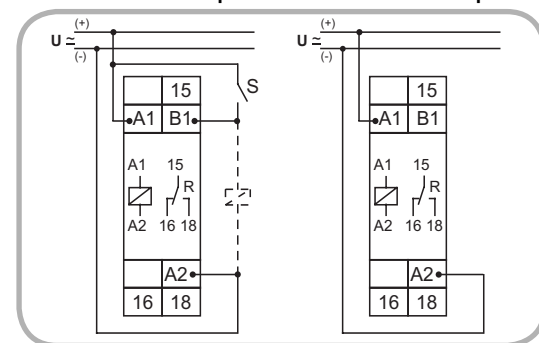


Ordering information

Types	Functions	Supply voltage	Part Nr. (PQ 1)	Part Nr. (PQ 10)
E1ZM10 12-240V AC/DC	E, R, Ws, Wa, Es, Wu, Bp	12-240V AC/DC	110100	110100A
E1ZM10 24-240V AC/DC	E, R, Ws, Wa, Es, Wu, Bp	24-240V AC/DC	110200	110200A
E1ZMQ10 24-240V AC/DC	E, R, Wu, Bp	24-240V AC/DC	110202	110202A
E1Z1E10 24-240V AC/DC	E	24-240V AC/DC		110204A

Single shot trailing edge with control input (Wa)

The supply voltage U must be constantly applied to the device (green LED U/t illuminated).

Closing the control contact S has no influence on the condition of the output R. When the control contact is opened, the output relay switches into on-position (yellow LED illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated), the output relay switches into off-position (yellow LED not illuminated). During the interval, the control contact can be operated any number of times. A further cycle can only be started when the cycle run has been completed.




ON delay with control input (Es)

The supply voltage U must be constantly applied to the device (green LED U/t illuminated).

When the control contact S is closed, the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay R switches into on-position (yellow LED illuminated). This status remains until the control contact is opened again.

If the control contact is opened before the interval t has expired, the interval already expired is erased and is restarted with the next cycle.



Single shot leading edge voltage controlled (Wu)

When the supply voltage U is applied, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated). This status remains until the supply voltage is interrupted. If the supply voltage is interrupted before the interval t has expired, the output relay switches into off-position. The interval already is erased and is restarted when the supply voltage is next applied.



Flasher pause first (Bp)

When the supply voltage U is applied, the set interval t begins (green LED U/t flashes). After the interval t has expired, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins again. After the interval t has expired, the output relay switches into off-position (yellow LED not illuminated).

The output relay is triggered at a ratio of 1:1 until the supply voltage is interrupted.

